


Top Secret

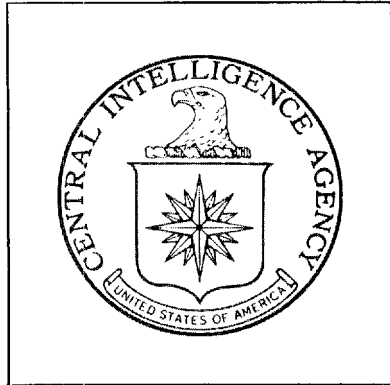

DIRECTORATE OF
INTELLIGENCE

Industrial Facilities
(Non-Military)

Basic Imagery Interpretation Brief

Shang-hsuan Hydro Power Plant (Yen-kuo Gorge)

Yen-kuo, China

25X1A

Top Secret

*Handle via Talent - Keyhole
Channels Only*

DECLASS REVIEW by NIMA/DOD

BCS 13/0118/69
TCS 12475/68
DATE JANUARY 1969
COPY 94
PAGES

WARNING

This document contains information affecting the national security of the United States within the meaning of the espionage laws U. S. Code Title 18, Sections 793, 794. The law prohibits its transmission or the revelation of its contents in any manner to an unauthorized person, as well as its use in any manner prejudicial to the safety or interest of the United States or for the benefit of any foreign government to the detriment of the United States. It is to be seen only by personnel especially indoctrinated and authorized to receive information in the designated control channels. Its security must be maintained in accordance with regulations pertaining to TALENT-KEYHOLE Control System.

GROUP 1 EXCLUDED FROM AUTOMATIC DOWNGRADING AND DECLASSIFICATION

[illegible]

Handle Via
Talent-KEYHOLE
Control System Only

TOP SECRET RUFF
Approved For Release 2001/09/04 : CIA-RDP79T00909A000100010031-8

BCS - 13/0118/69

IMAGERY ANALYSIS SERVICE

INSTALLATION OR ACTIVITY NAME					COUNTRY
Shang-hsuan Hydro Power Plant (Yen-kuo Gorge) 25X1A					CH
UTM COORDINATES	GEOGRAPHIC COORDINATES	CATEGORY	BE NUMBER	COMIREX NO.	WAC-PIC NO.
48SUR442918	36-03-30N 103-16-10E				0383-30
MAP REFERENCE					
15th RTS. USATC Series 200, Sheet 0383-21HL, 2nd edition, July 1964, Scale 1:200,000 (SECRET NO FOREIGN DISSEM) 25X1C					
LATEST IMAGERY USED			NEGATION DATE (If required)		
			Not Required		

NOTICE


The following report is designated as the Basic Report for this installation:

CIA/IAD. PIR 75010, Chinese Power Plants, Kansu Province
July 1966, TCS 3801/66 (TOP SECRET RUFF)

BASIC DESCRIPTION

Between [REDACTED] the date of the latest imagery used in the referenced report, and [REDACTED] the powerhouse was extended to house the seventh turbogenerator. There is space for an eighth turbogenerator which, when installed, will complete the powerhouse. Water turbulence was noted in the tailrace on all referenced photography.

REFERENCES



Requirement

EXSUBCOM - BR-N/002-69

Top Secret



Top Secret